




PS3-1

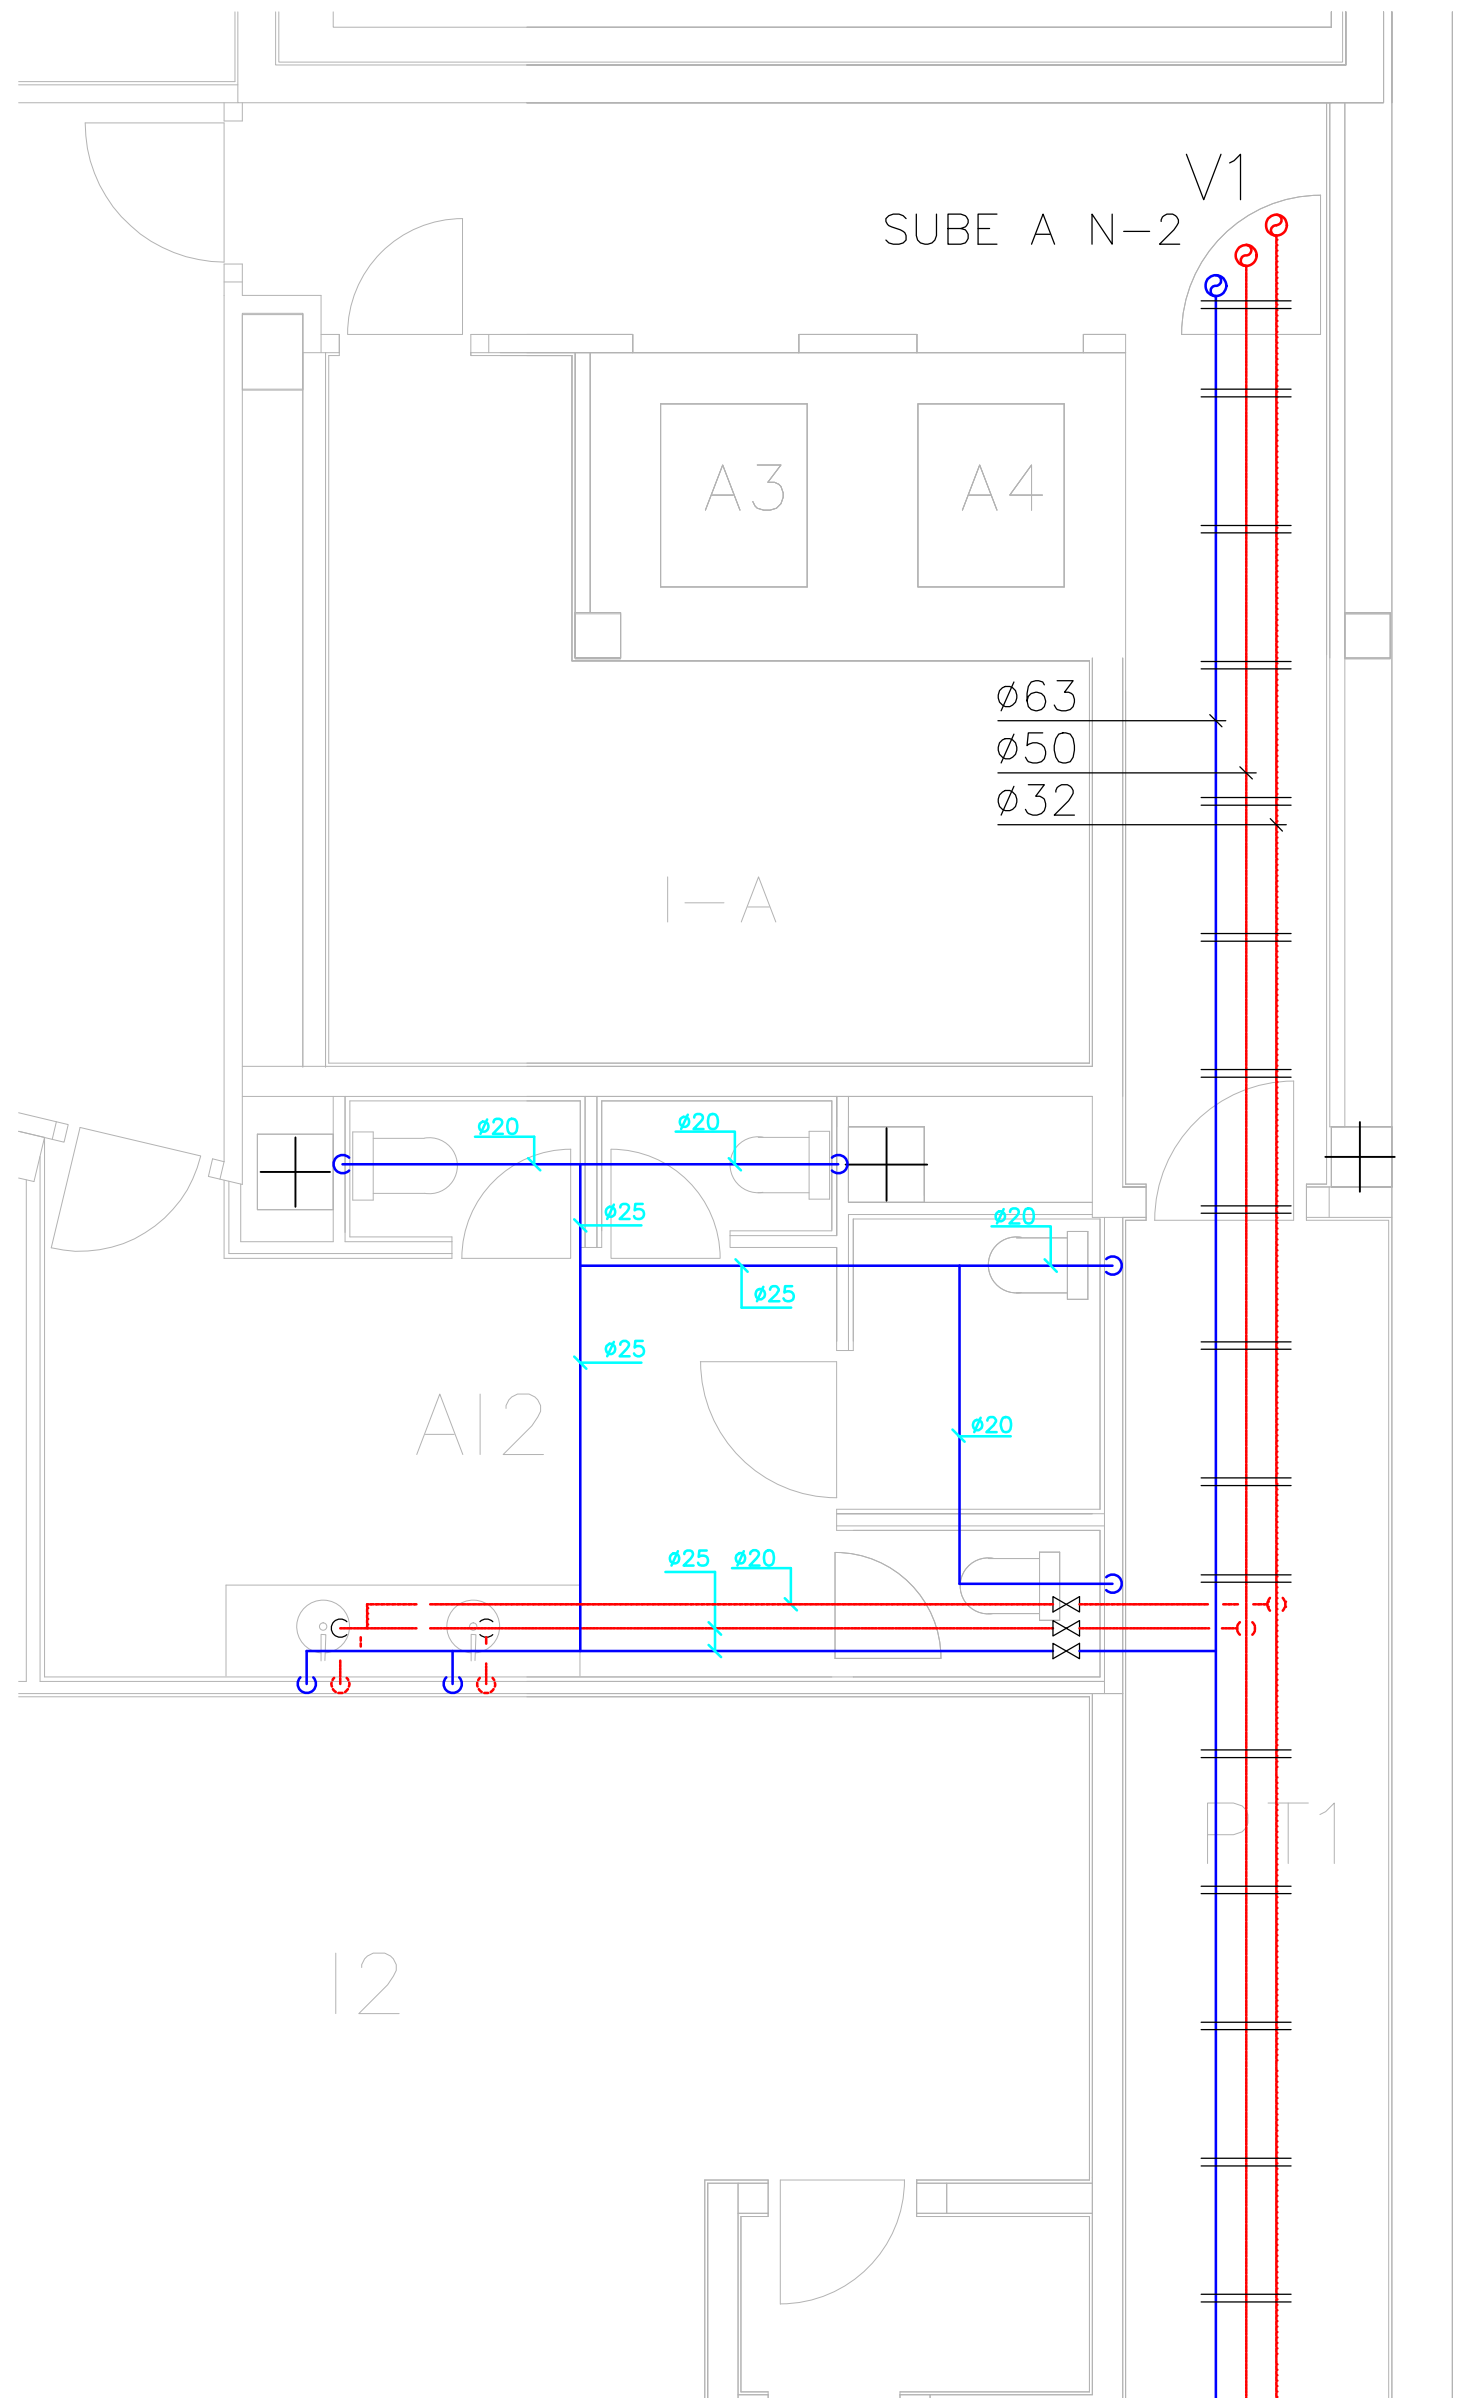


PS3-2

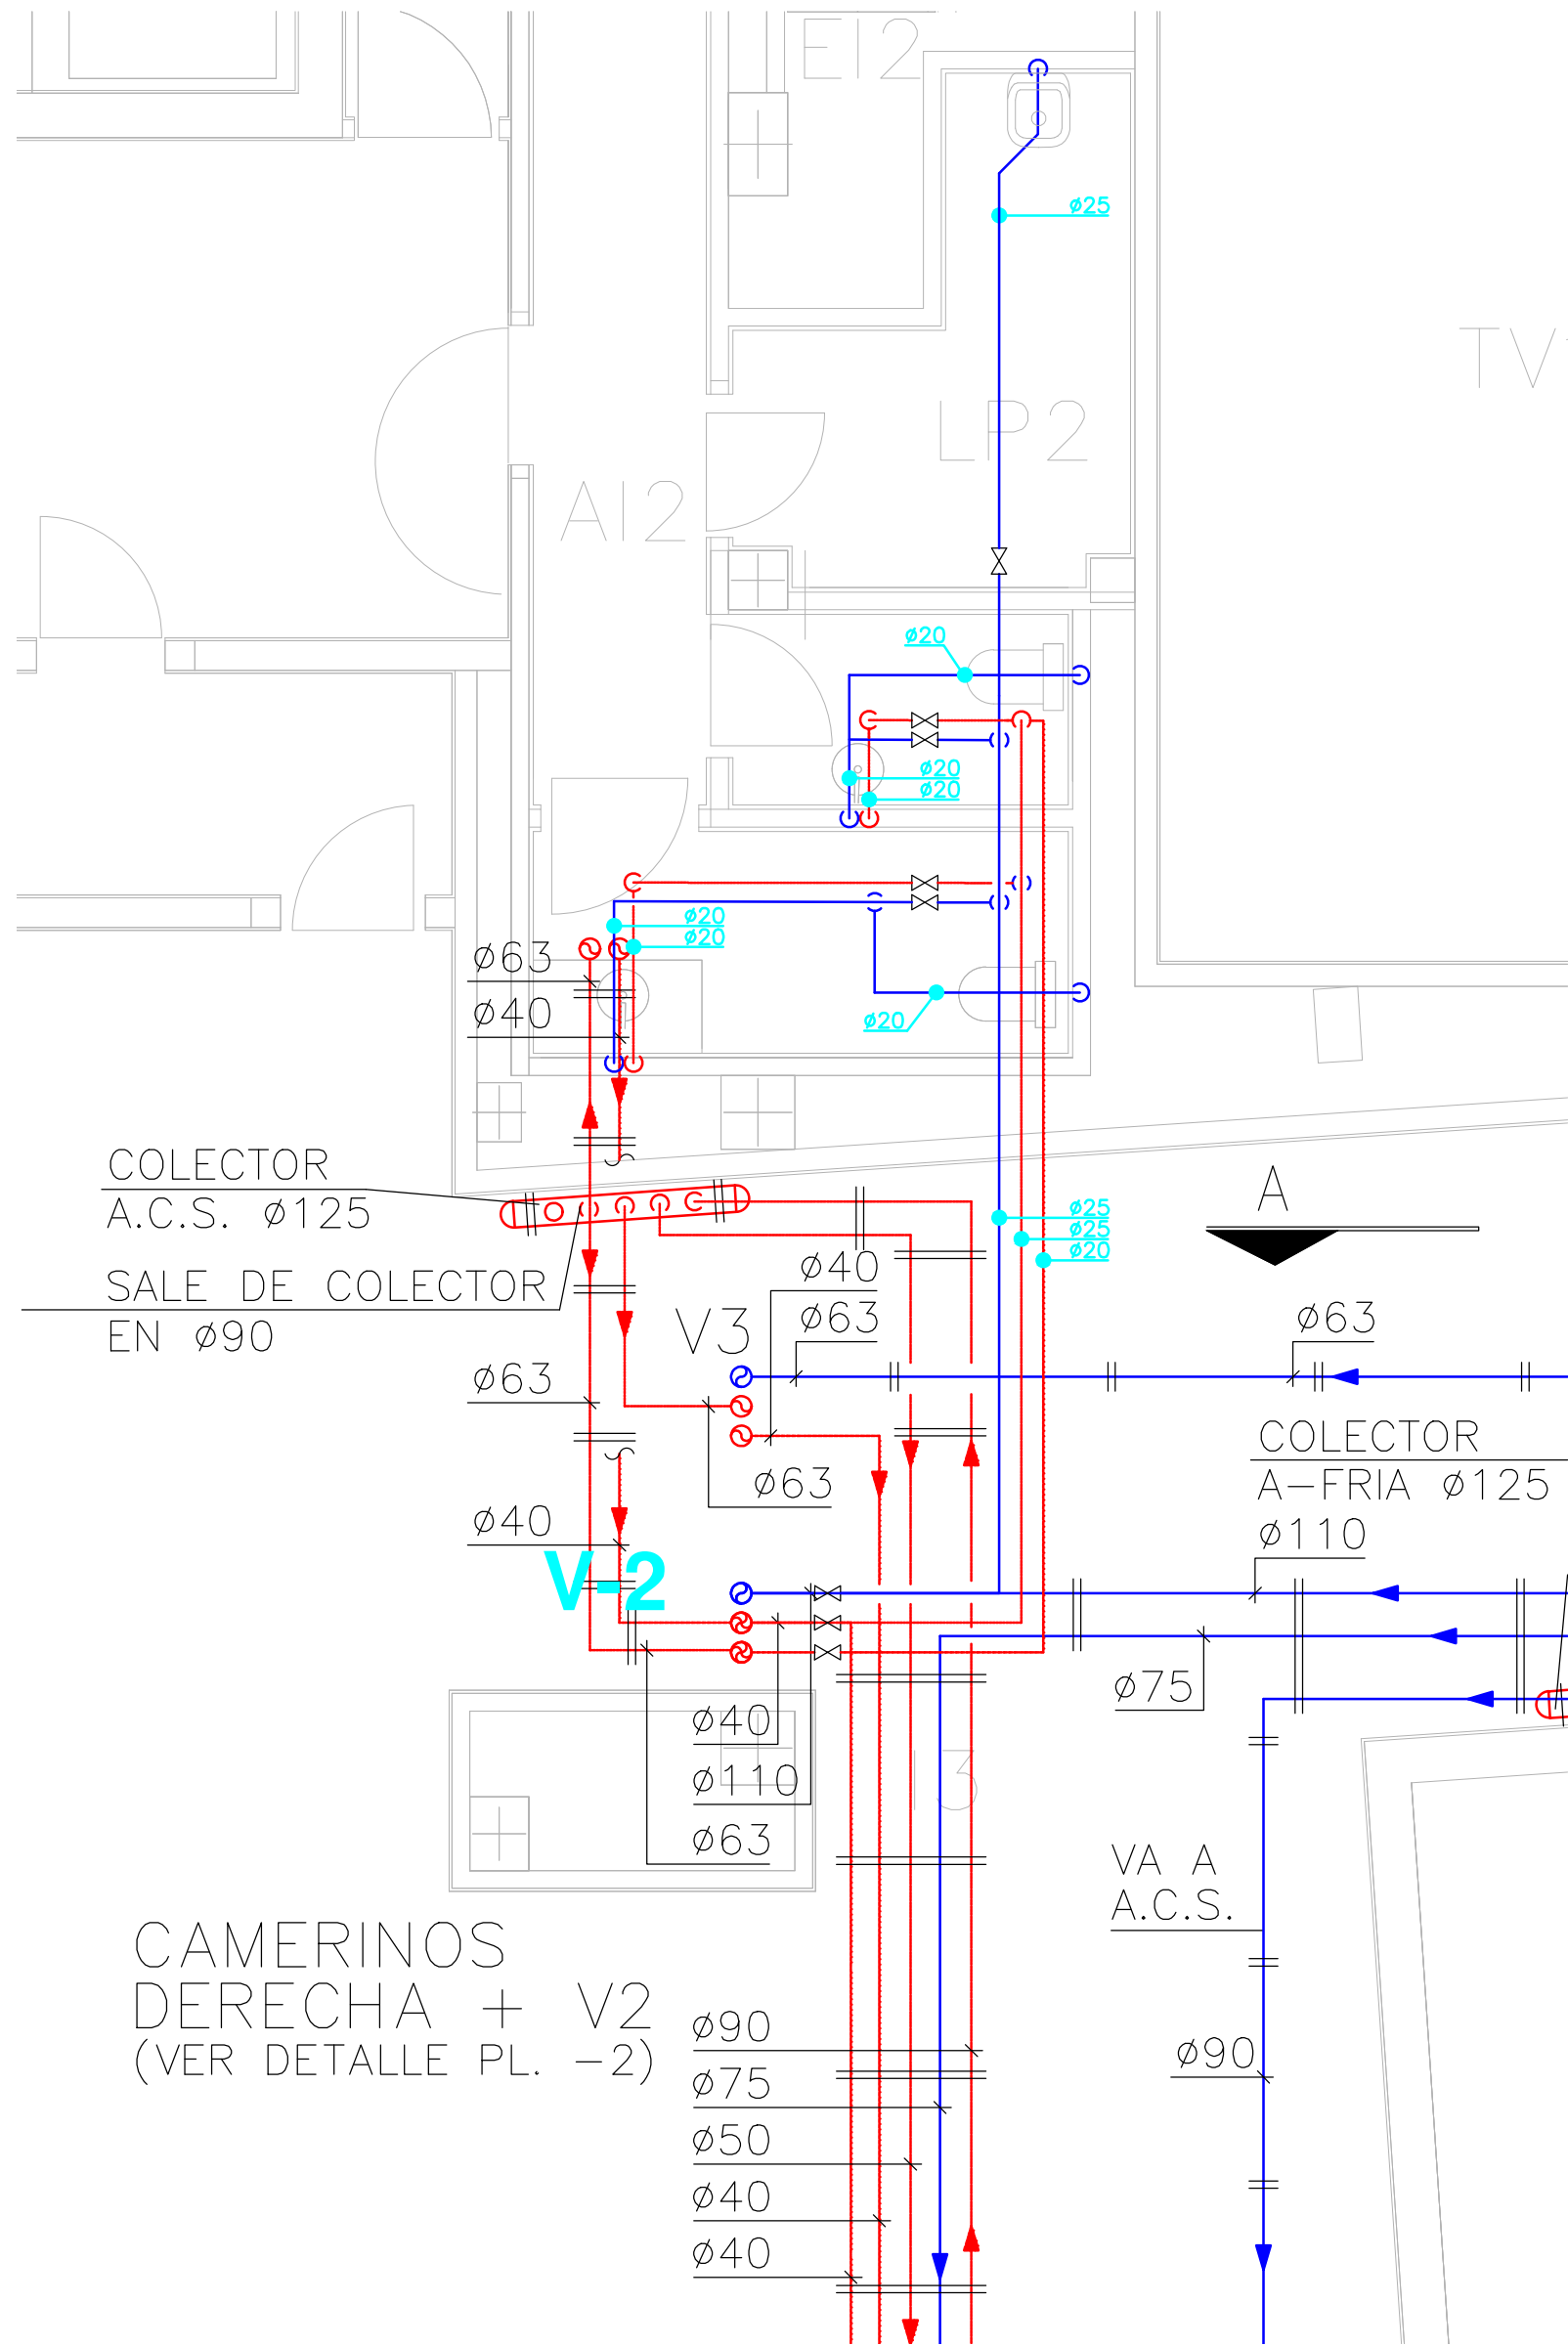

SECCION A-A

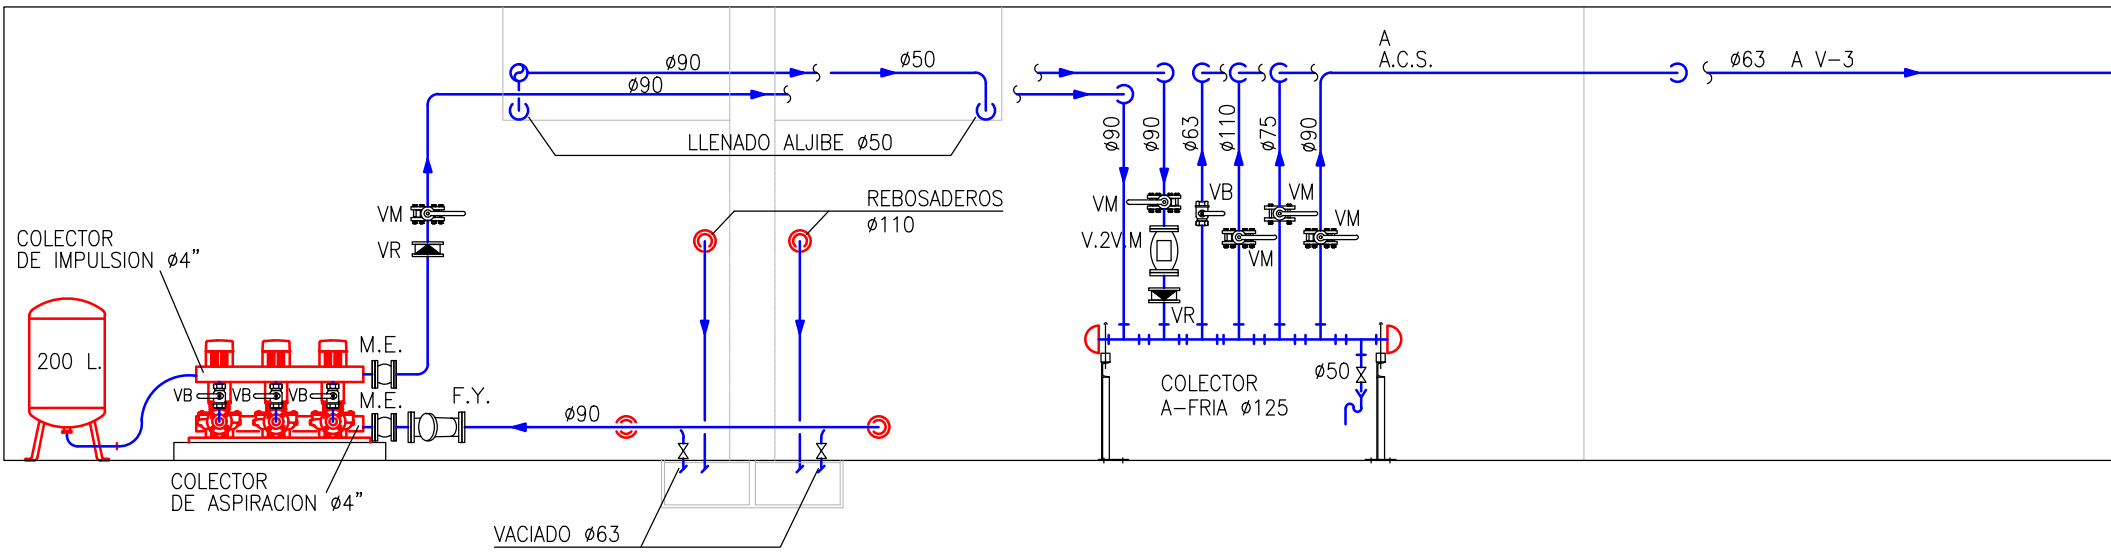

SECCION A-A

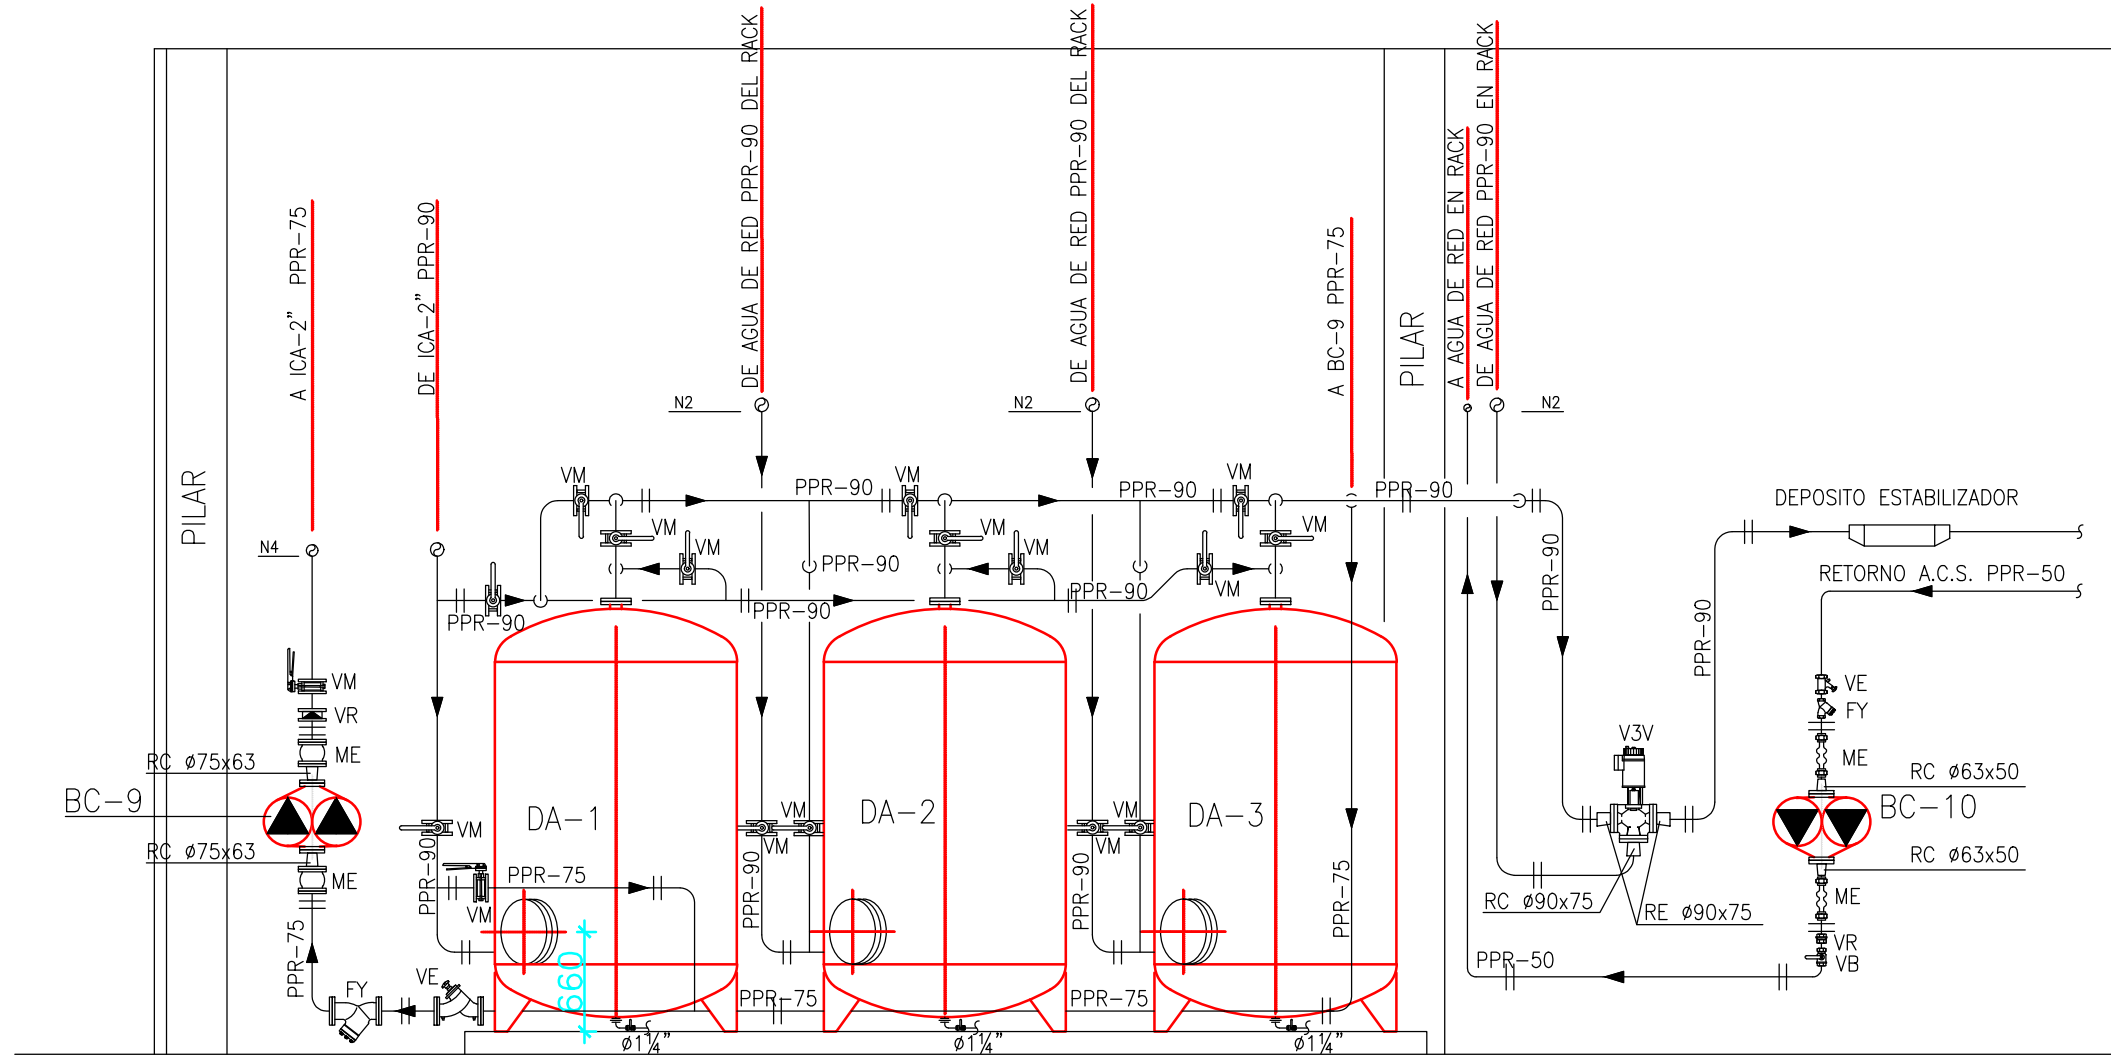


LEYENDA

- TUBERIA PPR AGUA FRIA
- TUBERIA PPR AGUA CALIENTE
- TUBERIA PPR AGUA CALIENTE RETORNO

TABLA CONSUMOS MINIMOS Y DIAMETROS DE CONEXION EN PUNTOS DE CONSUMO		
PUNTO DE CONSUMO	CAUDAL UNITARIO Lts/s	Ø CONEXION TUBERIA PPR
INODOROS	0.10	ø20
LAVABOS	0.10	ø20
BIDES	0.10	ø20
DUCHA	0.20	ø25
FREGADEROS	0.20	ø25
PILAS	0.10	ø20
VERTEDEROS	0.20	ø25
TOMAS DE AGUA	0.10	ø20

COMPARATIVO

ø110	ø4"
ø90	ø3"
ø75	ø2½"
ø63	ø2"
ø50	ø1½"
ø40	ø1¼"
ø32	ø1"
ø25	ø¾"
ø20	ø½"

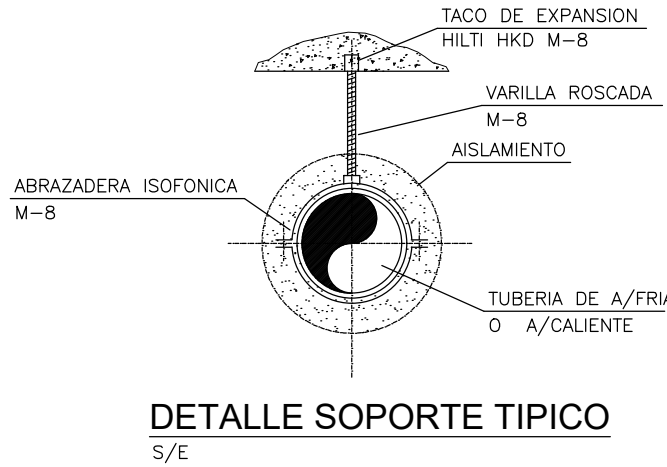

DISTANCIA ENTRE SOPORTES TUBERIAS

Ø	DISTANCIAS
20	0,60
25	0,75
32	0,90
40	1,00
50	1,20
63	1,40

PROYECTO: NUEVA INST. TERMOS ELÉCTRICOS INSTALACION FONTANERÍA
PRODUCCIÓN ACS POR ZONAS ACS
PLANTA -3 (COTA -5.00, -6.00)

CLIENTE: INGENIERIA: